




MONTÁŽNÍ NÁVOD

Tiskopis č. DS 1466/CZ/1003

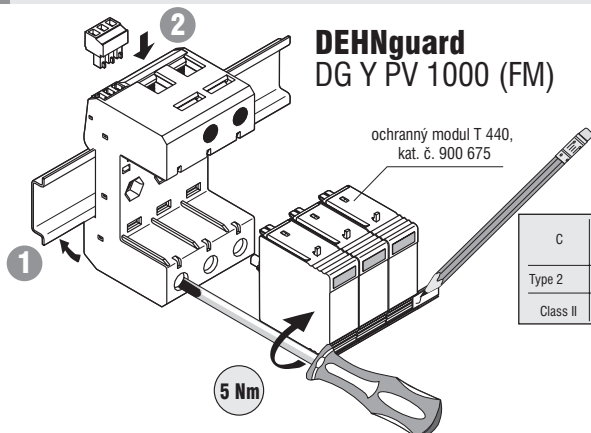

C	E DIN VDE 0675-6: ... based on -0675-6/AT: ...
Type 2	based on EN 61643-11: ...
Class II	IEC 61643-1: ...



Technické údaje

Typ	DEHNgard DG Y PV 1000 / DG Y PV 1000 FM ochranný modul T 440
$U_{OC\ STC}^*$	$\leq 1000\ V\ DC$
U_C	$L \rightarrow \perp$ 500 V DC $L - \rightarrow \perp$ 500 V DC
$\vartheta\ ^\circ C$	-40°C ... + 80°C
IP-Code	20


*) $U_{OC\ STC}$ podle IEC 60364-7-712: 2002-05

min. $\square L+, L-\perp$	1,5 mm ²		
max. $\square L+, L-\perp$	25 mm ²	35 mm ²	16 mm ²
	16 mm ² Cu		

Schéma zapojení solárního zařízení

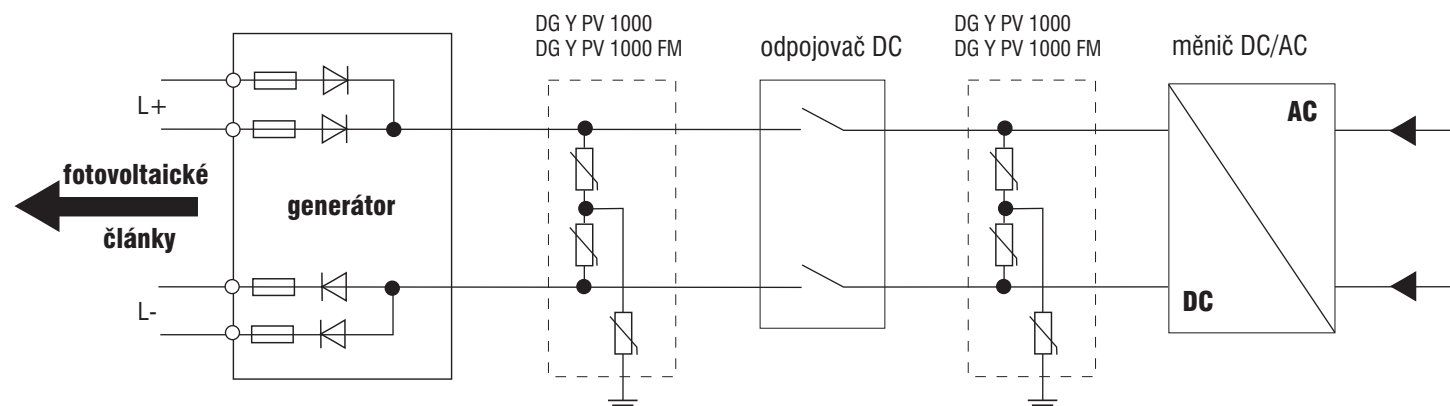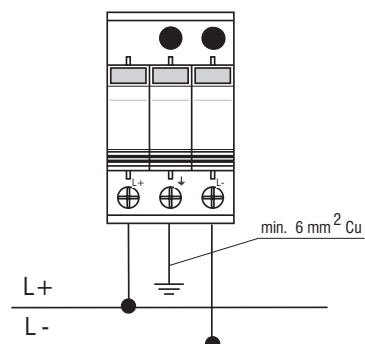

Signalizace poruchy




zelená



o.k.

ochranný modul T 440



červená



vyměnit

Kontakty DSF

DG Y PV 1000 FM	
	U_N / I_N
AC: 250 V / 0,5 A	
DC: 250 V / 0,1 A 125 V / 0,2 A 75 V / 0,5 A	
max. 1,5 mm ²	